


ABSORPOLE LABORATORY TEST

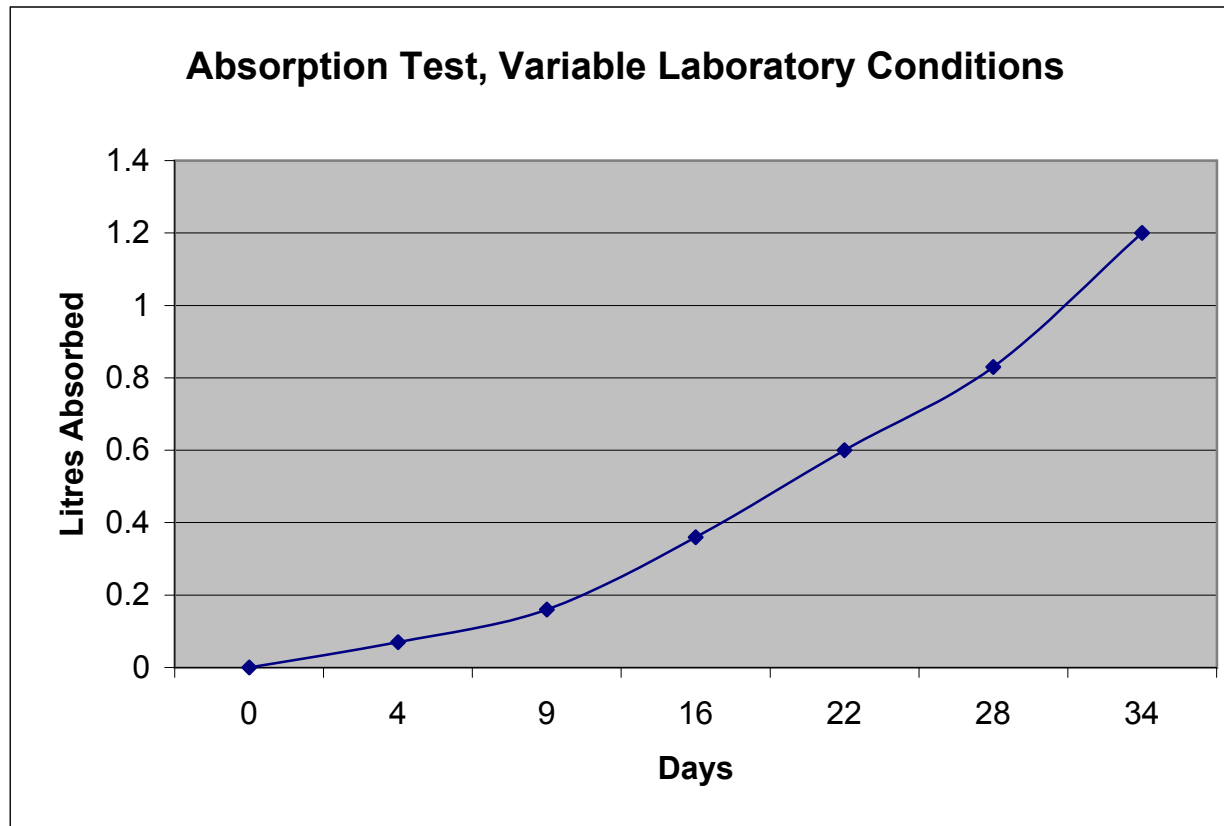

Temperature Variable: 10-25 C (simulated day/night cycles)

RH Variable: 70-90%

Reserve Capacity: At 34 days 0.35 Kg CaCl₂ Crystals in Collector, No crystals @ 115 days.

Original Quantity CaCl₂: 1.3 kg